



2017 IGSHPA CONFERENCE & EXPO

Nanocomposite Materials Used for Ground Heat Exchanger Pipes

Jean-Sébastien
Gosselin

Jasmin
Raymond

Stéphane
Gonthier

Mathieu
Brousseau

Jean-François
Lavoie

ABSTRACT

This study compares the performance of single U-pipe, double U-pipe, and coaxial ground heat exchangers (GHE) equipped with standard HDPE and thermally enhanced (TE) pipes. Sizing calculations and 10-year hourly simulations were carried out with the GLHEPro software using as input a synthetic thermal load profile of a reference, heating-dominated, medium office building located in the U.S. climate zone 5B enclosing Colorado. Energy consumption by the ground heat and ground loop pumps were then calculated from the simulated outputs. Finally, a life-cycle cost analysis was performed to compare the total costs (construction and operation) net present value of the GHEs equipped with TE pipes with those equipped with standard HDPE pipes. Results showed that the double U-pipe with thermally enhanced pipes was the best option for the conditions considered in the study. Depending on the configuration, the use of TE pipes instead of standard HDPE pipes allowed a reduction of the GHE length between 9 and 14.8% and a reduction of the construction cost between 3.3 and 8.6%. For each configuration tested, the operation costs were similar between the GHEs equipped with HDPE and TE pipes. This study demonstrates that GHEs equipped with TE pipes can be a financially viable and environmentally beneficial solution, especially if secondary benefits are factored in such as saved footprints on available real estate.

INTRODUCTION

Ground-coupled heat pumps are energy efficient and environmentally friendly systems for heating and cooling buildings but are expensive to install. The ground heat exchanger (GHE) is the most expensive component of the system. This is particularly true for vertical GHEs installed in boreholes that tend to be more expensive than horizontal installations in trenches. Technological innovations, such as space clips holding pipes separately and thermally enhanced grout ([Allan and Kavanaugh, 1999](#)) can be used to reduce the borehole thermal resistance, which translates in GHE fields with shorter and/or fewer boreholes that are cheaper to install. The thermal conductivity of the pipes is also a factor affecting the borehole thermal resistance. Typically, GHEs are built using high-density polyethylene (HDPE) pipes, which are actually thermal insulators that increase the thermal resistance of boreholes.

In recent years, significant research efforts have been made to develop thermally enhanced (TE) polymers with inorganic nanomaterial fillers due to potential applications in the automotive, aerospace, constructions, and electronic industries. These applications are for example heat sinks in electronic devices, tubing for heat exchangers, enclosures for electronic appliances, casing for small motors, and heat exchangers used in corrosive environments ([Gupta et al., 2009](#)). In the geothermal sector, commercial pipes made with HDPE resin loaded with a carbon filler have shown an increase of thermal conductivity by about 75% compared to traditional grades of HDPE used for pipes ([Versaprofiles, 2014](#)). Design calculations indicated that these thermally enhanced pipes can reduce the thermal resistance of vertical GHEs by 10 to 50%, depending on the proposed configuration using U-shaped or concentric pipes. This allows a 5 to 25% reduction of the total drilling length required to fulfill the building heating and cooling needs ([Raymond and Léger, 2011](#); [Raymond et al., 2011, 2015](#)).

Jean-Sébastien Gosselin (jean-sebastien.gosselin@ete.inrs.ca) is a postdoctoral student and [Jasmin Raymond](#) is a professor in geothermal energy at [INRS-ETE](#). Mathieu Brousseau and Jean-François Lavoie are engineers working at [Versaprofiles](#) that produce thermally enhanced pipes for ground-coupled heat pump systems. Stéphane Gonthier is the president of Versaprofiles.

While the aforementioned research showed the potential reduction of the boreholes thermal resistance and GHEs length, none have evaluated how much the use of TE pipes, which have currently a higher trade cost than conventional HDPE pipes, would impact the construction and operation costs of GHEs. The objective of this study was to evaluate the economic benefits of TE pipes by comparing sizing calculations and 10-year hourly simulations for various configurations of GHEs (single U-pipe, double U-pipe, and coaxial) equipped with standard HDPE and TE geothermal pipes. In addition to the construction costs, an energy analysis was carried out and allowed to take into account the operation costs of the ground heat and loop circulation pumps linked to the GHE field.

METHODOLOGY

Sizing calculations were carried out with the GLHEPro software (Ground Loop Heat Exchanger Professional; Spitler, 2000; Spitler et al., 2016), using as input, a synthetic thermal load profile of a reference, heating-dominated, medium office building located in the U.S. climate zone 5B enclosing Colorado (see Figure 1). Three different configurations of GHEs were considered: single U-pipe, double U-pipe, and coaxial (see Figure 2). For each configuration, a GHE was designed with standard HDPE and TE pipes using the full building loads. The operating conditions of each of the GHEs thus designed were then simulated on an hourly basis with GLHEPro over a 10-year period. The simulation outputs were then used to compute the electrical energy consumption of the ground heat pumps (GHP) and of the ground loop pumps (GLP) used to circulate the fluid. The results obtained from the sizing calculations and energy consumption analysis were then used to perform a life-cycle cost analysis to compare the economic performance of the GHEs equipped with TE pipes with those equipped with standard HDPE pipes.

GHE Design Specifications

Building Load Profile. Figure 1 presents the thermal load profile of a reference 4982 m² (53 628 ft²), 15 zones, three-story office building located in the U.S. climate zone 5B. This synthetic dataset was created by the Office of Energy Efficiency & Renewable Energy (EERE) with the EnergyPlus simulation software (Crawley et al., 2000) using a typical meteorological year at the Denver location. Heating demand is higher during the months of October to April and from May to June for cooling. Heating is dominant, with annual heating and cooling requirements of, respectively, 106.9 MW·h/yr and 66.1 MW·h/yr, corresponding to a heating on cooling ratio of 1.6.

Sizing calculation of the GHEs was carried out using monthly total and peak loads that were calculated from the hourly load profile using the *Peak Load Analysis Tool* distributed with GLHEPro. The maximum heating peak load occurred in January with a value estimated at 249.1 kW (850.0 kBtu/h) and a duration of 3 h, while the maximum cooling peak load occurred in June with an estimated value of 104.8 kW (357.6 kBtu/h) and a duration of 7 h.

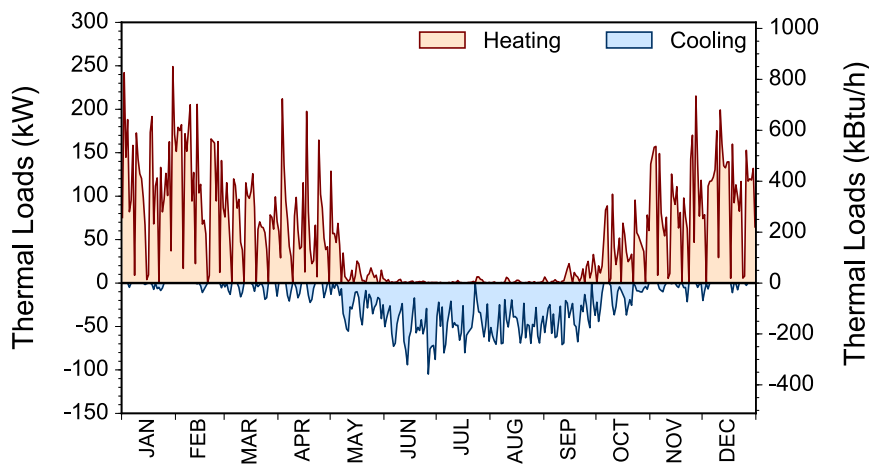


Figure 1: Typical one-year building load profile of a reference 4982 m² (53 628 ft²), 15 zones, three-story office building located in the U.S. climate zone 5B enclosing Colorado.

GHE Materials and Configurations. For each configuration considered (Figure 2), sizing calculations and 10-year hourly simulations were carried out for two different designs: one using thermally enhanced pipes and another using standard HDPE pipes. The boreholes were arranged in a rectangular grid pattern with a separation distance of 6 m (19.7 ft) (see Figure 3) to reduce the thermal interference between individual bores (ASHRAE, 2011). The GHE design strategy consisted in adding or removing boreholes from the borefield until the borehole depth was within 150 ± 10 m (492 ± 33 ft).

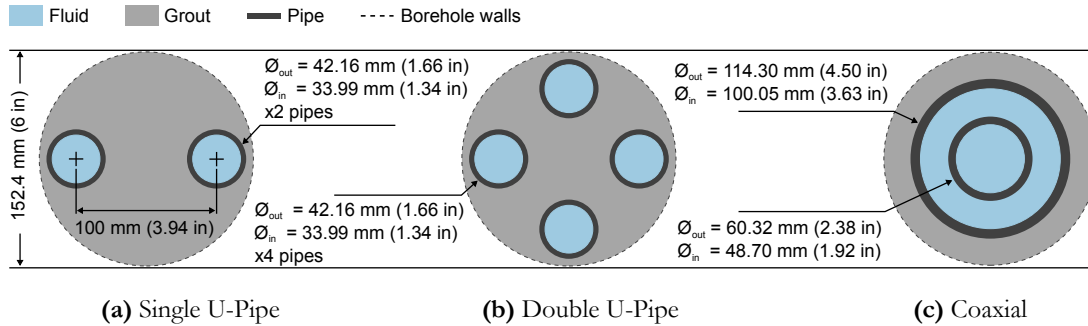


Figure 2: Scale drawing showing the pipe and the drilling dimensions of the three ground heat exchanger configurations considered in this study using, alternately, standard HDPE and thermally enhanced pipes.

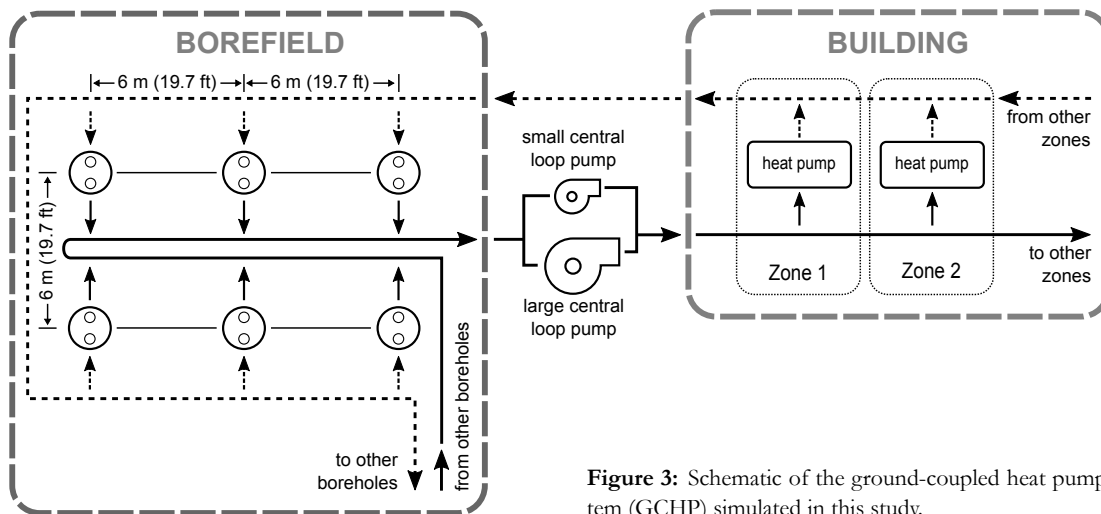


Figure 3: Schematic of the ground-coupled heat pump system (GCHP) simulated in this study.

All boreholes were assumed to have a diameter of 152.4 mm (6 in) and to be filled with a thermally enhance grouting with an average thermal conductivity of $1.9 \text{ W/m}\cdot\text{K}$ ($1.10 \text{ Btu/h}\cdot\text{ft}\cdot^\circ\text{F}$). Thermal conductivity of the subsurface was set to a constant value of $3.0 \text{ W/m}\cdot\text{K}$ ($1.74 \text{ Btu/h}\cdot\text{ft}\cdot^\circ\text{F}$), which is a value that is representative of a granite, limestone, or sandstone bedrock material (ASHRAE, 2011). The volumetric heat capacity for the subsurface and grouting were set, respectively, to $2343 \text{ kJ}/^\circ\text{C}\cdot\text{m}^3$ ($34.9 \text{ Btu}/\text{ft}^3\cdot^\circ\text{F}$) and $3901 \text{ kJ}/^\circ\text{C}\cdot\text{m}^3$ ($58.2 \text{ Btu}/\text{ft}^3\cdot^\circ\text{F}$).

The nominal diameter of the pipes used for the single and double U-pipe configuration was 31.8 mm (1.25 in) and the standard dimension ratio (SDR) was 11 (Figures 2a and 2b). Space clips, attached every 3 m (10 ft) along the U-pipe, were assumed to separate the pipes from each other with a center-to-center distance of 100 mm (3.94 in). This allowed to reduce the borehole thermal resistance and the thermal short-circuiting between the cold and hot leg of the U-pipes, consequently increasing the performance of the GHEs (Hellström, 1991; Claesson and Hellström, 2011). The thermal conductivity of standard HDPE and TE pipes were set, respectively, to a value of $0.4 \text{ W/m}\cdot\text{K}$ ($0.23 \text{ Btu/h}\cdot\text{ft}\cdot^\circ\text{F}$) and

0.7 W/m·K (0.41 Btu/h·ft·°F), as reported in Raymond et al. (2015), while the volumetric heat capacity was set to a value of 1543 kJ/°C·m³ (23.0 Btu/ft³·°F) for both types of pipe material.

The alternative coaxial design considered in this study (Figure 2c) involved the use of two pipes installed in each other. The size of the coaxial configuration was based on Raymond et al. (2015). The inner pipe had a nominal diameter of 50.8 mm (2 in) and a SDR of 11, while the outer pipe had a nominal diameter of 101.6 mm (4 in) and a SDR of 17. Two different cases for the coaxial were considered: one with an outer pipe made of HDPE and another with a TE pipe. In both cases, standard HDPE material was used for the inner pipe in order to minimize the thermal short-circuiting effect between the annulus and the inner pipe. The thermal conductivity and volumetric heat capacity for the HDPE and TE pipes were kept identical to the values given above for the U-pipe configurations.

Ground Heat Pumps Selection. Fifteen commercially available ground heat pumps (ClimateMaster, 2016) with a nominal capacity in heating of 22.6 kW (6.4 tons) were used to meet the maximum peak heating load of 249.1 kW (70.8 tons). The 15 GHPs were assumed to be all identical and connected in parallel to the GHEs (one GHP installed per building zone, see Figure 3). It was also assumed that the entering water temperatures (EWTs), both on the source and load side (building), were the same for all GHPs at all times. Therefore, all the GHPs were assumed to have the same coefficient of performance (COP) and capacity (CAP) when operating. Figure 4 shows the COP and CAP curve fits of the selected GHP as a function of the EWT at a flow rate of 0.9 L/s (14.2 gpm). These curves were estimated from the performance data sheets of the manufacturer.

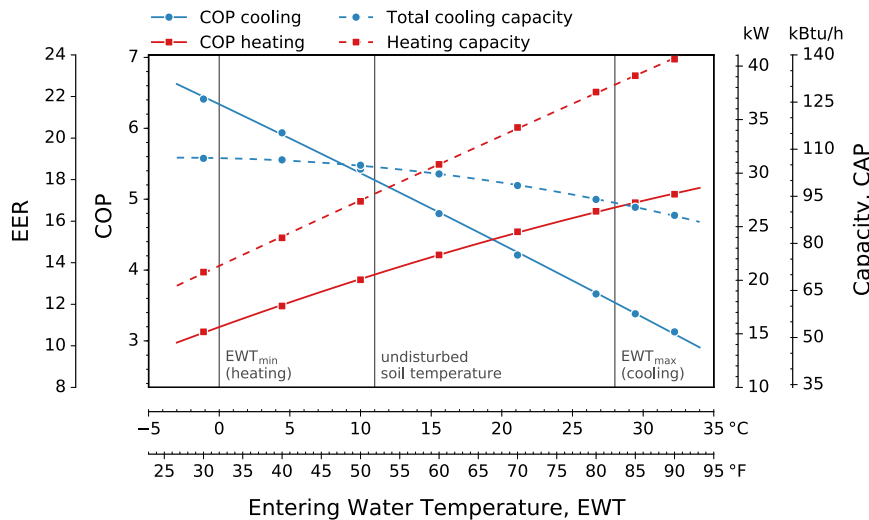


Figure 4: Curve fits of the coefficient of performance (COP) and total cooling and heating capacity (CAP) of the selected ground heat pump, estimated from the performance data sheets of the manufacturer, as a function of the entering water temperature at a flow rate of 0.9 L/s (14.2 gpm).

Design and Undisturbed Subsurface Temperatures. The undisturbed subsurface temperature was set to a value of 11 °C (51.8 °F), a value that is representative of locations in the 5B USA climate zone. For instance, the undisturbed ground temperature in the Denver area, Colorado, is about 11 °C (52 °F) according to McQuay International (2002).

Following ASHRAE (2011) guidelines, the minimum EWT in heating mode was set to 0 °C (32 °F), 11 °C (51.8 °F) below the undisturbed ground temperature. In cooling mode, the maximum EWT was set to 28 °C (82.4 °F), 17 °C (62.6 °F) above the undisturbed ground temperature.

Heat Carrier Fluid. According to CAN/CSA-C448 (2013), the heat-transfer fluid shall ensure freeze protection to at least 5 °C (9 °F) below the minimum loop design temperature. Compliance to this requirement was ensured by using a 25 wt % propylene glycol heat carrier solution, which is characterized by a freezing point of -10.44 °C (13.20 °F). A minimum concentration of 25 wt % is recommended to avoid problems of corrosion and bacteria. Table 1 presents the

thermophysical properties of the selected heat carrier fluid at the minimum design EWT of 0 °C (32 °F) in heating, as well as the minimum flow rate required in the U-pipe and coaxial configurations to ensure turbulent flow. Values for pure water are also provided for comparison.

Fluid property [†]	Units	Prop. Glycol	Pure Water
Dynamic viscosity	mPa·s (lb _m /ft·h)	5.91 (14.30)	1.77 (4.28)
Density	kg/m ³ (lb _m /ft ³)	1030.92 (64.36)	999.84 (62.42)
Min. turbulent flow rate [‡] :			
Single/Double U-pipe	L/s (gpm)	0.35 (5.58)	0.11 (1.72)
Coaxial	L/s (gpm)	1.66 (26.32)	0.51 (8.13)

[†] Fluid properties were calculated with the GLHEPro software (Spitler et al., 2016).

[‡] Flow is assumed turbulent at $Re > 2300$. See Figure 2 for dimensions of the U-pipe and coaxial GHEs.

Table 1: Heat carrier fluid (25 wt % propylene glycol) and pure water properties at the design minimum EWT of 0 °C (32 °F). The freezing point of 25 wt % propylene glycol is -10.44 °C (13.21 °F).

Loop Pump Design. Each and every U-pipe and coaxial loops were assumed to be connected in parallel (see Figure 3) to the main header and to have the same volumetric flow rate. Similarly, the GHPs were assumed to be all connected in parallel to a one-pipe loop system and to be activated on and off synchronously since they operate under identical conditions.

The one-pipe loop system was assumed to be equipped with a large central pump with on-off control and variable speed drives ensuring a constant nominal flow rate at various head losses (due to fluid temperature variations). The large pump and motor efficiency were assumed constant with mean values of, respectively, 70 and 90 % based on values used by Kavanaugh (2011). The central loop pump was assumed to be cycled off when the GHPs were not activated. A constant hydraulic pressure of 90 kPa (30 ft of water head) was maintained within the loop during these off times by a smaller central pump that operated in parallel at 25 % of the design volumetric flow rate. The smaller central loop pump was assumed to be cycled off when the GHPs were activated. The smaller pump and motor efficiency were also considered to be constant with values of, respectively, 50 and 85 % based on values used by Kavanaugh (2011). Note that the heat rejected to the ground by the pumps was not considered in the sizing calculation and hourly simulation of the GHEs since this component could not be directly accounted for in the GLHEPro software.

Design Volumetric Flow Rate. The total volumetric flow rate \dot{V} was designed to ensure a ratio of 0.054 L/s/kW (3 gpm/ton) of heating load during peak conditions. Considering that the maximum heating peak load is 249.1 kW (850.0 kBtu/h), the design volumetric flow rate is estimated at 13.5 L/s (214 gpm) for the entire system or 0.9 L/s (14.2 gpm) per GHP.

For the coaxial configuration, the design volumetric flow rate had to be increased from this calculated value to ensure non-laminar flow ($Re > 2300$) on each and every loop of the GHE at the design EWT in heating mode. The design volumetric flow rate was calculated in this case by multiplying the minimum turbulent flow rate in heating mode of Table 1 by the number of coaxial boreholes determined during the sizing calculations.

Energy Consumption Analysis

Heat Pump Performance. The GHPs operating time in heating (OT_h) and cooling mode (OT_c) within a given 1-hour time interval τ was calculated using the curve fits of CAP (Figure 4) and the simulated EWT as:

$$OT_h[\tau] = \frac{1}{N_{GHP}} \cdot \frac{Q_h[\tau]}{CAP_h(EWT[\tau])} \quad \text{and} \quad OT_c[\tau] = \frac{1}{N_{GHP}} \cdot \frac{Q_c[\tau]}{CAP_c(EWT[\tau])} \quad (1)$$

where N_{GHP} is the total number of ground heat pumps and Q_h and Q_c are the hourly building heating and cooling loads. The total electrical power (W_{GHP}) consumed by the 15 GHPs over the 10-year simulation period was then calculated

using the curve fits of COP and CAP (Figure 4) and the OT calculated with Equation 1:

$$W_{GHP} = N_{GHP} \times \sum_{\tau=1}^{24 \times 365 \times 10} \left(\frac{CAP_h(EWT[\tau])}{COP_h(EWT[\tau])} \cdot OT_h[\tau] + \frac{CAP_c(EWT[\tau])}{COP_c(EWT[\tau])} \cdot OT_c[\tau] \right) \quad (2)$$

Pumping Energy. The energy consumed by the ground loop pumps (GLPs) may account for a significant portion of the building annual energy consumption (Bernier, 2001). The electrical consumption of the large and smaller loop pumps (W_{GLP}) over the 10-year simulation period was evaluated with the following equation:

$$W_{GLP} = \sum_{\tau=1}^{24 \times 365 \times 10} \left(OT_{tot}[\tau] \cdot \frac{\dot{V}}{\eta_{pump}^{large} \cdot \eta_{motor}^{large}} \cdot \Delta p_{on}[\tau] + (1 - OT_{tot}[\tau]) \cdot \frac{0.25 \dot{V}}{\eta_{pump}^{small} \cdot \eta_{motor}^{small}} \cdot \Delta p_{off} \right) \quad (3)$$

where n_{pump} and n_{motor} refer, respectively, to the pumping and motor efficiency of the large and small loop pumps, \dot{V} is the design volumetric flow rate, Δp_{on} is the time-varying pressure drop in the loop system while the GHPs are activated, Δp_{off} is the constant pressure head of 90 kPa (30 ft of water head) delivered by the smaller loop pump when the GHPs are not activated and OT_{tot} is the total period of time during which the GHPs are operated within a given 1-hour time interval τ and corresponds to the sum of $OT_h[\tau]$ and $OT_c[\tau]$.

Only the pressure drop in the borehole pipes and in the water coil of the GHPs were considered for the calculation of Δp_{on} . The pressure drops in the return and supply header, valves and pipeline fittings were neglected. The water pressure drop (WPD) in the GHPs was determined with a curve fit of the performance data sheets of the selected GHP (ClimateMaster, 2016). For the single and double U-pipe configurations, Δp_{on} was calculated as the sum of the WPD and the pressure drop in the descending and ascending legs of the U-pipe. For coaxial configurations, Δp_{on} was calculated as the sum of the WPD and the pressure drop in the annular duct and in the inner pipe conduit.

Assuming non-laminar flow conditions at all times ($Re > 2300$), the pressure drop for circular pipe flow was calculated at every time step τ with the equations presented in VDI-Gesellschaft (2010):

$$\Delta p_{pipe}[\tau] = f_{pipe} \frac{L_{pipe}}{d_i} \frac{\rho[\tau] w_{pipe}^2}{2} \quad \text{with} \quad f_{pipe} = 0.3164 Re[\tau]^{-1/4} \quad (4)$$

where f_{pipe} , L_{pipe} , and d_i are, respectively, the friction factor, the length, and the inside diameter of the pipe, w_{pipe} is the average velocity of the fluid in the pipe, ρ is the fluid density, and Re is the Reynolds number. The pressure drop for annular flow was calculated at every time step τ with the equations presented in Gnielinski (2009):

$$\Delta p_{ann}[\tau] = f_{ann}[\tau] \frac{L_{ann}}{d_h} \frac{\rho[\tau] w_{ann}^2}{2} \quad \text{with} \quad f_{ann}[\tau] = \left(1.8 \log_{10} \left(Re[\tau] \frac{(1+a^2) \ln a + (1-a^2)}{(1-a)^2 \ln a} \right) - 1.5 \right)^{-2} \quad (5)$$

where f_{ann} and L_{ann} are, respectively, the friction factor and length of the annulus, w_{ann} is the average velocity of the fluid in the annulus, a is the ratio between the outer diameter of the inner tube and the inner diameter of the outer tube, and d_h is the hydraulic diameter, which corresponds to the length between the inner diameter of the outer tube and the outer diameter of the inner tube. The Reynolds number Re is calculated using the hydraulic diameter d_h . The fluid properties (density and dynamic viscosity) were estimated in Equations 4 and 5 for every time step τ by linear interpolation using property tables that were produced with the GLHEPro software.

Cost Analysis

To assess the economic performance of GHEs equipped with thermally enhanced pipes, a life-cycle cost analysis was performed, which consisted in calculating the construction cost of the GHE field and the net present value (NPV) of 10 years of operation of the GCHP system. The construction cost of the GHEs included the cost of drilling, installation labor, heat transfer fluid, grout, spacer clips and pipes. Table 2 presents the material and labor costs that were used to

calculate the borehole construction cost for the various configurations considered in this study. The costs are given for a borehole of 152 m (500 ft) length. All other construction costs were assumed the same from one configuration to another and were excluded from the analysis. This included the cost of the heat and loop pumps, of the horizontal pipes and trenches, and of the geothermal vault.

The operation cost included the NPV of the electrical energy used by the heat and loop pumps over the 10-year simulation period (see Equations 2 and 3). All other sources of operation costs were excluded from this analysis. The NPV of 10 years of operation was evaluated by the following equation (Park, 2010):

$$\text{Operation Cost Net Present Value} = \sum_{n=1}^{10} \frac{(W_{GPH}[n] + W_{GLP}[n]) \cdot EC \cdot (1 + I_E)^n}{(1 + i)^n} \quad (6)$$

where n is the year number, I_E is the electricity escalation rate assumed to be 3% and i is the constant discount rate assumed equal to 6% based on values used in Bernier (2006) and Hénault et al. (2016), EC is the average electricity cost in USA assumed equal to 10.60 ¢/kW·h based on EIA (2016), and n is the yearly index.

	Single U-pipe		Double U-pipe		Coaxial	
	HDPE	TE	HDPE	TE	HDPE	TE
Material Costs (\$US)						
Loop	570	915	1240	1930	2000	3000
Heat carrier fluid	24	24	47	47	89	89
Grout	750	750	614	614	387	387
Spacer clips	147	147	147	147	0	0
Labor Costs (\$US)						
Installation	650	650	650	650	1300	1300
Drilling	8000	8000	8000	8000	8000	8000
Total borehole cost (\$US)	10 141	10 486	10 698	11 388	11 776	12 776

Table 2: Material and labor costs details in \$US calculated for a single borehole of 152 m (500 ft) for the three GHE configurations (single U-pipe, double U-pipe, and coaxial) and two pipe materials (HDPE and TE) considered in this study.

RESULTS

Results for the sizing calculations, energy consumption, and cost analysis are presented for each GHE configuration in Table 3. Also, percentage reduction of the borehole thermal resistance and total GHE field length, area, and construction costs obtained when using TE pipes instead of HDPE pipes are presented in Table 4 for each configuration considered.

DISCUSSION

Sizing calculation. Depending on the configuration, results in Table 4 show that the use of TE pipes instead of standard HDPE pipes allowed a reduction of the borehole thermal resistance between 22.3 and 24.4% and a reduction of the total GHE length between 9.0 and 14.8%. As shown in Table 3, the double U-pipe configuration equipped with TE pipes has the smallest GHE design length, with a total borehole length that is 31.1% shorter compared to the single U-Pipe GHE equipped with standard HDPE pipes. This important reduction is not only due to the lower thermal resistance of the TE double U-pipe configuration, but also because of its greater heat storage capacity that helps to dampen the impact of peak loads on the required length of the GHE (Raymond et al., 2015). Similarly, coaxial GHEs have 3.8 times more heat storage capacity than the single U-pipe GHEs. This explains why the calculated length for the HDPE and TE coaxial GHEs are smaller than those for single U-pipe by, respectively, 13.2% and 16.2%, even though the coaxial thermal resistance is higher in both cases.

Table 3: Results summary for the sizing calculation, energy consumption analysis, and cost analysis for the three GHE configurations (single U-pipe, double U-pipe, coaxial) and two types of pipe material tested (HDPE and TE). NPV = Net Present Value; TE = Thermally Enhanced.

	Units	Single U-pipe		Double U-pipe		Coaxial	
		HDPE	TE	HDPE	TE	HDPE	TE
GHE Sizing Calculation							
Design flow rate, \dot{V}	L/s	13.5	13.5	13.5	13.5	18.7	15.3
	gpm	214	214	214	214	296	243
Borehole thermal resistance	m·K/W	0.0865	0.0672	0.0488	0.0372	0.0926	0.0700
	h·ft·°F/Btu	0.1497	0.1163	0.0845	0.0644	0.1603	0.1212
Number of boreholes	–	12	11	10	9	11	9
Borehole length	m	158	152	143	145	149	155
	ft	518	499	469	476	489	509
GHE field length	m	1891	1669	1432	1303	1641	1398
	ft	6204	5476	4698	4275	5384	4587
GHE field area	m ²	432	396	360	324	396	324
	ft ²	4650	4263	3875	3488	4263	3488
Energy Analysis (Yearly Average)							
Heat pump power, W_{GHP}	kW·h/yr	42 648	42 712	42 832	42 910	40 999	42 150
	kBtu/yr	145 521	145 739	146 149	146 415	146 719	143 822
Loop pumps power, W_{GLP}	kW·h/yr	8257	8510	6960	7128	9580	7708
	kBtu/yr	28 174	29 037	23 749	24 322	32 688	26 301
Total Operation Power	kW·h/yr	50 906	51 223	49 793	50 038	50 579	49 859
	kBtu/yr	173 698	174 780	169 901	170 737	172 583	170 126
Cost Analysis							
Real estate footprint [†]	\$	116 250	106 563	96 875	87 188	106 563	87 188
Average operation cost	\$US/yr	5396	5429	5278	5304	5361	5285
10 years operation cost NPV	\$US	46 235	46 524	45 225	45 448	45 941	45 286
Borehole construction cost	\$US/bore	10 462	10 438	10 090	10 845	11 553	12 998
GHE field construction cost	\$US	125 554	114 823	100 904	97 611	127 090	116 986

[†] Based on a land sale price of 269 \$ per buildable square meter (25 \$ per buildable square foot).

Table 4: For each GHE configuration, % reduction of the borehole thermal resistance and total GHE field length, area, and construction costs obtained when using TE pipes instead of HDPE pipes.

TE vs HDPE % reduction for the:	Single U-pipe	Double U-pipe	Coaxial
Borehole thermal resistance	22.3	23.8	24.4
Total GHE field length	11.7	9.0	14.8
Real estate footprint	8.3	10.0	18.2
Total GHE field construction cost	8.6	3.3	8.0

Energy analysis. Results from the energy analysis show that the power consumption of the GHPs is very similar for all U-pipe GHEs, ranging from 42 648 kW·h/yr (145 521 kBtu/yr) for the HDPE single U-pipe to 42 910 kW·h/yr (146 415 kBtu/yr) for the TE double U-pipe. Assuming an electricity cost of 10.60 ¢/kW·h, this corresponds to a difference of less than 30 \$/yr for the operation cost of the GHPs. This shows that the use of TE pipes does not significantly affect the performance of the GHP when sizing calculations are done properly. The GHP energy consumption of the coaxial GCHP systems are the lowest due to the increased flow rate, which helps improving the performance of the GHPs. On the other hand, this is counterbalanced by a higher loop pumping power consumption that is mainly due to the increased pressure drop within the inner pipe of the coaxial GHEs. This could have been mitigated by the use of baffles, mounted within the annulus, to enforce turbulence at lower flow rates (Steins et al., 2012). It is also worth noting that the double U-pipe GHEs require about 16 % less pumping energy than the single U-pipe GHEs. This is explained by the fact that, for an equal total flow rate of 13.5 L/s (214 gpm), the mean velocity of the fluid in each loop connected in parallel to the main header is more than twice lower for the double U-Pipe than for the single U-Pipe. As per Equation 4, this results in a significant reduction of the pressure drop and a lower loop pumping power consumption when the large loop pump is operated. For the same reasons, the power consumption for pumping is slightly higher for all the GHEs equipped with TE pipes since the number of boreholes connected in parallel to the main header is less than those equipped with standard HDPE pipes.

Cost analysis. Results for the life-cycle analysis (Table 3) reveal that the 10 years of operation NPV are very similar for all the GHE configurations considered, ranging from 45 225 \$ for the HDPE double U-pipe to 46 524 \$ for the TE single U-pipe. The TE double U-pipe GHE have the lowest construction cost and appears to be the best option, both technically and financially, for the conditions represented in this work. In contrast, the coaxial GHEs have the greatest construction costs due to the higher trade and installation costs of the coaxial loops (see Table 2). Results in Table 4 show that TE pipes allowed a reduction of the construction costs between 3.3 and 8.6 % when respectively compared to GHEs with same configuration and regular HDPE pipes. In all cases, these results suggest that GHEs equipped with TE pipes are an economically viable solution, despite the current typical trade cost of TE pipes being almost two times higher than standard HDPE pipes.

Furthermore, secondary benefits of using TE pipes to reduce the size of the GHE fields must also be factored in. As shown in Table 3, the reduction of the number of boreholes also allows to lower the total land area that is required to build the GHE fields. For larger geothermal project in urban areas where space is limited and where the land sale price per buildable square foot is high, a reduction in the number of boreholes by about 10 % could represent significant additional savings on the initial cost of a project. Table 4 shows that in this study, the use of TE pipes instead of standard HDPE pipes allowed an additional saving of 8.3, 10.0 and 18.2 % on the real estate value, respectively, for the single U-pipe, double U-pipe, and coaxial configuration. Moreover, less drilling length also means less fuel consumption during construction, smaller carbon footprint, shorter time of installation, less drilling residue, and less horizontal trench work. Besides, the trade cost of TE pipes can be expected to decrease in the future, which will increase even more the benefit of using TE pipes for the construction of GHEs. Of course, as with any cost analysis, the results presented here depends on the assumptions used. Benefit of using TE pipes may be greater or lower depending on drilling, material, and labor costs that can vary greatly from one location to the other in North America.

CONCLUSION

This study compared the performances of single U-pipe, double U-pipe, and coaxial ground heat exchangers (GHE) equipped with standard HDPE and thermally enhanced (TE) pipes. Sizing calculations and 10-year hourly simulations were carried out with the GLHEPro software using as input a synthetic thermal load profile of a reference, heating-dominated, medium office building located in the U.S. climate zone 5B enclosing Colorado. Energy consumption by the ground heat and ground loop pumps were then calculated from the simulated outputs and a life-cycle cost analysis was performed to compare the costs of construction and operation of the GHEs equipped with TE pipes with those equipped with standard HDPE pipes.

Results showed that the double U-pipe equipped with TE pipes was the best configuration for the conditions considered in this study. Depending on the configuration, the use of TE pipes instead of standard HDPE pipes allowed a reduction of the GHE length between 9.0 and 14.8% and a reduction of the construction cost between 3.3 and 8.6%. For each configuration tested, the operation costs were similar between the GHEs equipped with HDPE and TE pipes. This study demonstrates that GHEs equipped with TE pipes can be a financially viable and environmentally beneficial solution, especially if secondary benefits are factored in such as saved footprints on available real estate, a shorter time and smaller cost of installation, smaller carbon footprints, and less drilling residue. Future work on this topic will include the development of a tool to quickly and easily carry out sizing, performance and cost comparison analyses for a wide range of situations to present a more precise and realistic insight into the pros and cons of using TE pipes in the construction of GHE.

ACKNOWLEDGMENTS

The authors would like to kindly acknowledge Professor Jeffrey Spitler at Oklahoma State University for providing a non-commercial license of GLHEPro for doing this study. This research was supported by the Mitacs Accelerate scholarship of Jean-Sébastien Gosselin and the NSERC-discovery grant of Professor Jasmin Raymond. We thank the anonymous reviewers for their very helpful comments on the paper. The synthetic building load profile was downloaded free of charge from the OpenEI database (en.openei.org).

REFERENCES

- Allan, M.L., Kavanaugh, S.P., 1999. Thermal conductivity of cementitious grouts and impact on heat exchanger length design for ground source heat pumps. *HVAC&R Research* 5, 85–96. doi:[10.1080/10789669.1999.10391226](https://doi.org/10.1080/10789669.1999.10391226).
- ASHRAE, 2011. 2011 ASHRAE Handbook - HVAC Applications. Si edition ed., American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, GA.
- Bernier, M.A., 2001. Ground-coupled heat pump system simulation. *ASHRAE Transactions* 107, 12.
- Bernier, M.A., 2006. Closed-loop ground-coupled heat pump systems. *ASHRAE Journal*, 12–19.
- CAN/CSA-C448, 2013. Design and installation of earth energy systems. Canadian Standards Association, Mississauga, Ontario, Canada.
- Clæsson, J., Hellström, G., 2011. Multipole method to calculate borehole thermal resistances in a borehole heat exchanger. *HVAC&R Research* 17, 895–911. doi:[10.1080/10789669.2011.609927](https://doi.org/10.1080/10789669.2011.609927).
- ClimateMaster, 2016. Submittal Data - Tranquility Compact Belt Drive (TC) Series. Technical Report LC517. ClimateMaster. Oklahoma City, OK, USA. URL: <http://www.climatemaster.com>.
- Crawley, D.B., Pedersen, C.O., Lawrie, L.K., Winkelmann, F.C., 2000. EnergyPlus: Energy Simulation Program. *ASHRAE Journal* 42, 49–56.
- EIA, 2016. Electric Power Annual 2014. Technical Report. U.S. Energy Information Administration (EIA). Washington, DC 20585, United States. URL: www.eia.gov.
- Gnielinski, V., 2009. Heat transfer coefficients for turbulent flow in concentric annular ducts. *Heat Transfer Engineering* 30, 431–436. doi:[10.1080/01457630802528661](https://doi.org/10.1080/01457630802528661).
- Gupta, R.K., Kennel, E., Kim, K.J., 2009. *Polymer Nanocomposites Handbook*. CRC Press.
- Hellström, G., 1991. Ground Heat Storage - Thermal Analyses of Duct Storage Systems. Ph.D. thesis. University of Lund. Department of mathematical physics, Lund, Sweden.
- Hénault, B., Pasquier, P., Kummert, M., 2016. Financial optimization and design of hybrid ground-coupled heat pump systems. *Applied Thermal Engineering* 93, 72–82. doi:[10.1016/j.applthermaleng.2015.09.088](https://doi.org/10.1016/j.applthermaleng.2015.09.088).
- Kavanaugh, S., 2011. Less pumping means cooler ground loops. *ASHRAE Journal* 53.
- McQuay International, 2002. Geothermal Heat Pump - Design Manual. Technical Report Application Guide AG 31-008. Staunton, Virginia, USA.

- Park, C.S., 2010. *Contemporary Engineering Economics*. 5 edition ed., Prentice Hall, Boston.
- Raymond, J., Frenette, M., Léger, A., Magni, É., Therrien, R., 2011. Numerical modeling of thermally enhanced pipe performances in vertical ground heat exchangers. *ASHRAE Transactions* 117.
- Raymond, J., Léger, A., 2011. Le dimensionnement de systèmes géothermiques avec tuyaux Geoperformx. *GeoConneXion Magazine* Winter-Spring 2011, 16–20.
- Raymond, J., Mercier, S., Nguyen, L., 2015. Designing coaxial ground heat exchangers with a thermally enhanced outer pipe. *Geothermal Energy* 3, 1.
- Spitler, J.D., 2000. GLHEPRO - a design tool for commercial building ground loop heat exchangers, in: *Proceedings of the fourth international heat pumps in cold climates conference*, Aylmer, Quebec, Canada. pp. 17–18.
- Spitler, J.D., Marshall, C., Manickam, A., Dharapuram, M., Delahoussaye, R.D., Yeung, K.W.D., Young, R., Bhargava, M., Mokashi, S., Yavuzturk, C., Haider, M., Xu, X., Cullin, J., Dickinson, B., Lee, E., Grundmann, R., 2016. *Users' Guide for GLHEPro 5.0 for Windows*. Technical Report. School of Mechanical and Aerospace Engineering. Oklahoma State University, Stillwater, Oklahoma, United States.
- Steins, C., Al-Sibai, F., Kneer, R., 2012. Influence of large coaxial borehole heat exchangers (storage type borehole heat exchangers) on heat transfer and heat extraction, in: *Geothermal Energy Congress 2012*, Karlsruhe, Germany.
- VDI-Gesellschaft, 2010. *VDI Heat Atlas*. VDI-Verlag GmbH, Dusseldorf, Germany, Berlin; London.
- Versaprofiles, 2014. HDPE pipe with increased thermal conductivity for geothermal applications. Technical Report. Saint-Lazare-de-Bellechasse, Québec, Canada. URL: <http://www.versaprofiles.com/>.